

NOTES:

1. HYDRANT TO BE SET AT CURB RETURN.
2. VALVES SHALL NOT BE LOCATED UNDER CURB AND GUTTER, OR CONCRETE PAN.
3. A 5.0' CLEAR DISTANCE MUST BE MAINTAINED AROUND HYDRANT.
4. ALL MEASUREMENTS ARE TO THE OUTSIDE OF PIPE.
5. AN EASEMENT IS REQUIRED FOR UTILITIES OUTSIDE OF RIGHT-OF-WAY. EASEMENT DIMENSIONS AS SHOWN ARE THE MINIMUM. EASEMENT DIMENSIONS SHALL MEET THE MINIMUM REQUIREMENTS OF THE APPROPRIATE WATER DISTRICT.

SCALE: NTS




TOWN OF MEAD STANDARD DESIGN CRITERIA

FIRE HYDRANT PLACEMENT

D5.01

DATE: 04/2021

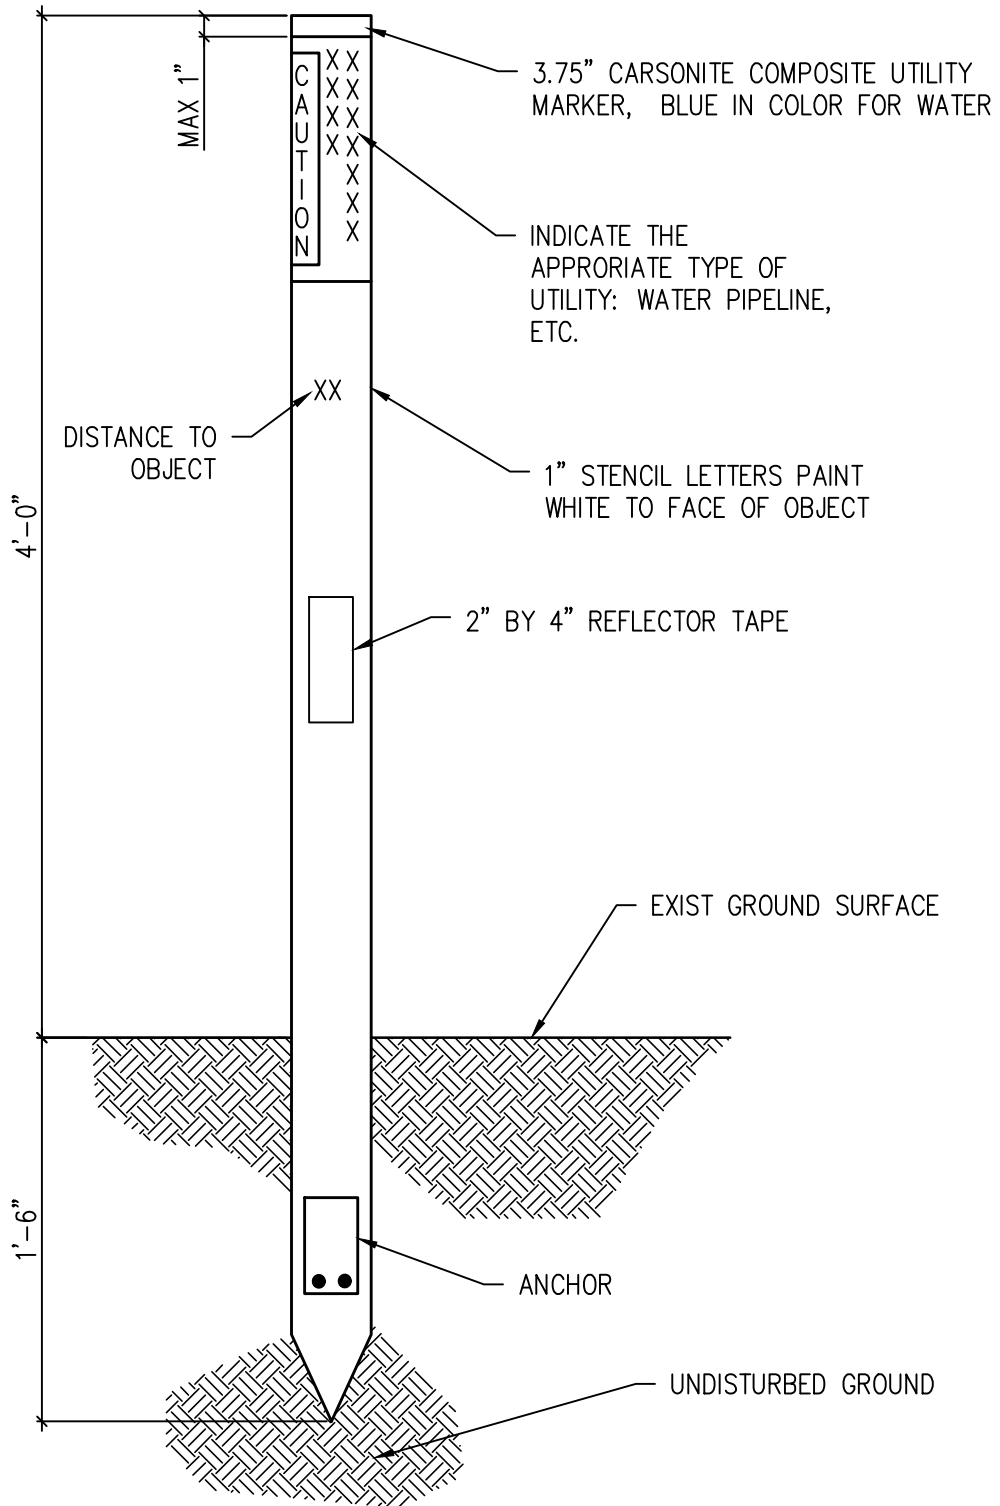

SCALE: NTS



TOWN OF MEAD STANDARD DESIGN CRITERIA

WATER UTILITY MARKER POST

D5.02

DATE: 04/2021